



**Certification Body:**



ABN: 81 663 250 815  
JASANZ Accreditation  
No. Z4450210AK  
PO Box 273,  
Palmwoods Qld 4555  
Australia  
P: +61 7 5445 2199  
[www.cmicert.com.au](http://www.cmicert.com.au)  
[office@cmicert.com.au](mailto:office@cmicert.com.au)

**Certificate Holder:**



Delta Panels Pty Ltd  
ABN: 11 147 861 292  
731 Boundary Road,  
Richlands, QLD, 4077  
Australia  
Ph: 07 3271 2170  
[www.deltapanel.com.au](http://www.deltapanel.com.au)

# Certificate of Conformity

**Certificate number: CM40330 Rev1**

**THIS IS TO CERTIFY THAT**

## DeltaTrim™ DualCore™ & DeltaOrb™ DualCore™ Panels

**Type and/or use of product:**

Roof panel for Non-Habitable Buildings and Structures are situated within 900mm of a site boundary and attached or adjacent to a Class 1a building.

**Description of product:**

An insulated Roofing panel consisting of two pre-painted, roll-formed steel skin profiles; either DeltaTrim™ or DeltaOrb™; bonded to a Mineral Wool (minimum coverage 900mm) and fire retardant SL Grade Expanded Polystyrene core (EPS). Refer A2 for more information.

**COMPLIES WITH THE FOLLOWING BCA PROVISIONS AND STATE OR TERRITORY VARIATION(S)**

**BCA 2022 (Amdt. 2)**

	Volume One	Volume Two
<b>Performance Requirement(s):</b>	Not Applicable	H3P1(1) Will contribute to Spread of fire subject to the Limitations and conditions below.
<b>Deemed-to-Satisfy Provision(s):</b>	Not Applicable	Not Applicable
<b>State or territory variation(s):</b>	Not Applicable	Not Applicable

**SUBJECT TO THE FOLLOWING LIMITATIONS AND CONDITIONS AND THE PRODUCT TECHNICAL DATA IN APPENDIX A AND EVALUATION STATEMENTS IN APPENDIX B**

**Limitations and conditions:**

- The DeltaTrim™ DualCore™ & DeltaOrb™ DualCore™ Panels contribute to compliance with H3P1(1) where the roof system is located within 900mm of a boundary. Compliance with H3P1(1) is subject to site specific performance solution to the satisfaction of the Appropriate Authority as described by the NCC and the following limitations and conditions.
- Installation must be in accordance with the requirements outlined in Section A5 of this Certificate of Conformity.
- The portion of the roof system which is located within 900 mm of a site boundary shall consist solely of non-combustible components including:
  - The DeltaTrim™DualCore™ or DeltaOrb™DualCore™ Panels with the portion of the Mineral Wool Core at the boundary end.
  - Steel fixtures, gutters and the like
  - Steel columns, beams, purlins and the like
  - Metallic flashing
- The DeltaTrim™DualCore™ & DeltaOrb™DualCore™ Panels must slope towards the boundary with the Mineral Wool section at the boundary end as per [DeltaDualCore V2025.05.26](#).
- The SL Grade Expanded Polystyrene core (EPS) has not been tested in accordance with AS 1530.1-1994 for non-combustibility.
- In the absence of testing to AS 1562.1:2018, roof panels installation must be treated as non-trafficable roofs.
- In the absence of a site-specific performance solution, this product or system must not be used to facilitate the exemptions for a carport specified in Part 9.2.8 of the ABCB Housing Provisions, and the NCC 2022.

**Building classification/s:**

Class 10a

  
Glen Gugliotti – CMI



Don Grehan – Unrestricted Building Certifier

**Date of issue:** 11/12/2025

**Date of expiry:** 28/09/2027



# Certificate of Conformity

8. Other than the items and information listed, the remainder of the information contained in the product's literature is outside the scope of this certification.
9. The use of the certified product/system is subject to these Limitations and Conditions and must be read in conjunction with the Scope of Certification below.

**Scope of certification:** The CodeMark Scheme is a building product certification scheme. The rules of the Scheme are available at the ABCB website [www.abcb.gov.au](http://www.abcb.gov.au). This Certificate of Conformity is to confirm that the relevant requirements of the Building Code of Australia (BCA) as claimed against have been met. The responsibility for the product performance and its fitness for the intended use remain with the Certificate Holder. The certification is not transferrable to a manufacturer not listed on Appendix A of this certificate.

Only criteria as identified within this Certificate of Conformity can be used for CodeMark certification claims. Where other claims are made in a client's Installation Manual, Website or other documents that are outside the criteria on this Certificate of Conformity, such criteria cannot be used or claimed to meet the requirements of this CodeMark certification.

The NCC defines a Performance Solution as one that complies with the Performance Requirements by means other than a Deemed-to-Satisfy Solution. A Building Solution that relies on a CodeMark Certificate of Conformity that certifies a product against the Performance Requirements cannot be considered as Deemed-to-Satisfy Solution.

This Certificate of Conformity may only relate to a part of a Performance Solution. In these circumstances other evidence of suitability is needed to demonstrate that the relevant Performance Requirements have been met. The relevant provisions of the Governing Requirements in Part A of the NCC will also need to be satisfied.

This Certificate of Conformity is issued based on the evidence of compliance as detailed herein. Any deviation from the specifications contained in this Certificate of Conformity is outside of this document's scope and the installation of the certified product will not be covered by this Certificate of Conformity.

**Disclaimer:** The Scheme Owner, Scheme Administrator and Scheme Accreditation Body do not make any representations, warranties or guarantees, and accept no legal liability whatsoever arising from or connected to, the accuracy, reliability, currency or completeness of any material contained within this certificate; and the Scheme Owner, Scheme Administrator and Scheme Accreditation Body disclaim to the extent permitted by law, all liability (including negligence) for claims of losses, expenses, damages and costs arising as a result of the use of the product(s) referred to in this certificate.

When using the CodeMark logo in relation to or on the product/system, the Certificate Holder makes a declaration of compliance with the Scope of Certification and confirms that the product is identical to the product certified herein. In issuing this Certificate of Conformity, CMI Certification Pty Ltd (CMI) has relied on the experience and expertise of external bodies (laboratories and technical experts).

Nothing in this document should be construed as a warranty or guarantee by CMI, and the only applicable warranties will be those provided by the Certificate Holder.


## APPENDIX A – PRODUCT TECHNICAL DATA

### A1 Type and intended use of product


As per page 1.

### A2 Description of product


DeltaTrim™DualCore™ & DeltaOrb™DualCore™ Panels consist of a top skin consisting of 0.45mm Colorbond® Steel and a bottom skin consisting of 0.55mm UniCote® Steel. The panels are available in a thickness of 75mm, 100mm, 125mm or 150mm wide in various lengths. DeltaTrim™DualCore™ & DeltaOrb™DualCore™ Panels consist of a Mineral Wool section (minimum coverage 900mm) and fire retardant SL Grade Expanded Polystyrene core (EPS) covers the remainder of the panel.

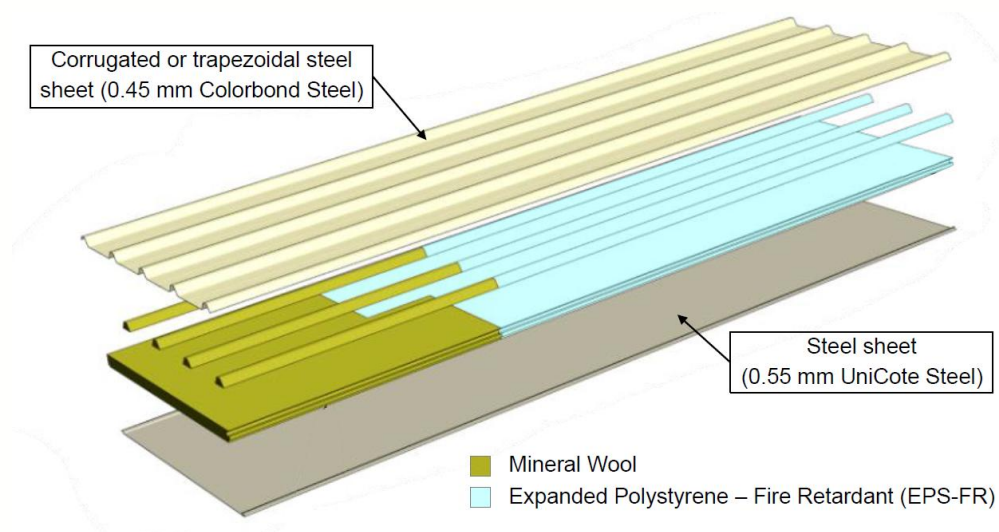

DeltaOrb™DualCore™

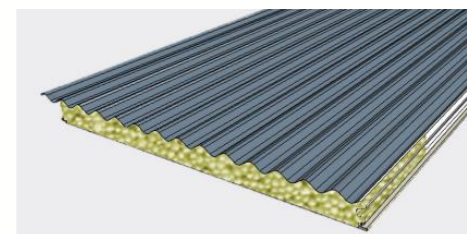

DeltaTrim™DualCore™

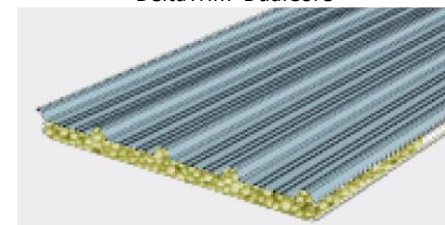

DeltaTrim™DualCore™ Fixing Details Crest fixing only. One fixing every second crest			DeltaOrb™DualCore™ Fixing Details Crest fixing only. One fixing every second crest		
Panel Thickness	Fixing into Steel	Fixing into Timber	Panel Thickness	Fixing into Steel	Fixing into Timber
75mm	Tek 14 x 150mm Hex Head Screw	T17 14 x 150mm Hex Head Screw	75mm	Tek 14 x 135mm Hex Head Screw	T17 14 x 150mm Hex Head Screw
100mm	Tek 14 x 175mm Hex Head Screw	T17 14 x 175mm Hex Head Screw	100mm	Tek 14 x 150mm Hex Head Screw	T17 14 x 175mm Hex Head Screw
125mm	Tek 14 x 200mm Hex Head Screw	T17 14 x 200mm Hex Head Screw	125mm	Tek 14 x 175mm Hex Head Screw	T17 14 x 200mm Hex Head Screw
150mm	Tek 14 x 230mm Hex Head Screw	T17 14 x 230mm Hex Head Screw	150mm	Tek 14 x 200mm Hex Head Screw	T17 14 x 230mm Hex Head Screw

Use Cyclone Plate and Neo Washer on each fixing. Upon Installation the overlap needs to be stitch screwed or riveted every 300mm.

<b>Roof Pitch</b>	DeltaTrim™DualCore™ ≥ 2°	DeltaOrb™DualCore™ ≥ 3°.	<b>Slope Direction:</b>	The DeltaTrim™DualCore™ & DeltaOrb™DualCore™ Panels must slope towards the boundary with the Mineral Wool section at the boundary end.
-------------------	--------------------------	--------------------------	-------------------------	--

# Certificate of Conformity

## A3 Product specification

### Spread of Fire

The Assessment of DeltaTrim™DualCore™ & DeltaOrb™DualCore™ Panels has confirmed that the roofing system will contribute to compliance with the performance requirements of H3P1 when installed in accordance with the requirements outlined in Section **A5 Installation requirements** of this Certificate of Conformity and subject to the aforementioned limitations and conditions.

The roofing system is limited to Class 10a Non-Habitable Buildings and Structures attached or adjacent to a Class 1a building positioned directly adjacent to the site boundary (i.e. less than 900 mm from the site boundary) where the DeltaTrim™DualCore™ or DeltaOrb™DualCore™ Panels must run perpendicular and must slope towards the boundary with the Mineral Wool section at the boundary end.

As the DeltaDualCore™ panel constitutes a bonded laminate, the following restrictions shall apply to the portion of the panel that is within 900mm of the site boundary:

- i. The laminas shall be restricted to steel facings with mineral wool core, each of which has been tested to AS 1530.1 and are deemed non-combustible.
- ii. Each adhesive layer may not exceed 1 mm in thickness and the total combined thickness of adhesive layers may not exceed 2mm.
- iii. The spread of flame index and the smoke developed index of the bonded laminated material as a whole shall not exceed 0 and 3 respectively.

Only the portion of each DeltaDualCore™ panel containing a mineral wool core shall comply with items i) to iii). The panel is cannot comply with NCC H3D3 as a whole.

The comparative assessment has demonstrated qualitatively and quantitatively that the DeltaDualCore™ system does not increase the risk of fire spread from or to an associated Class 1 building when compared to the DtS base case.

*Source: SOTERA Pty Ltd; Fire Engineers Report; DeltaDualCore™ Panel Class 10a Awning and Patio Roof System; Rev 1-12; Dated 27/05/2025.*

## A4 Manufacturer and manufacturing plant(s)

Delta Panels Pty Ltd  
731 Boundary Road,  
Richlands, QLD 4077.

## A5 Installation requirements

Installation must be in accordance with the [DeltaDualCore V2025.05.26](#). The DeltaTrim™DualCore™ or DeltaOrb™DualCore™ Panels must run perpendicular and must slope towards the boundary with the Mineral Wool section at the boundary end as per [DeltaDualCore V2025.05.26](#). All components used in the construction must comply with the specifications outlined in Section **A2 Description of product** of this Certificate of Conformity and [DeltaDualCore V2025.05.26](#). The components shall not be modified. The structure must not provide direct vertical support to any part of the adjacent Class 1 building. The portion of the awning system which is located within 900 mm of a site boundary shall consist solely of non-combustible components including:

- i. Steel fixtures, gutters and the like
- ii. Steel columns, beams, purlins and the like
- iii. Metallic flashing

## A6 Other relevant technical data

No other relevant technical data.

## APPENDIX B – EVALUATION STATEMENTS

### B1 Evaluation methods

1. Spread of Fire Provisions A5G3(1)(d)&(e). Reports from a professional engineer supported by reports from Accredited Testing Laboratories.

### B2 Reports

1. SOTERA Pty Ltd; Fire Engineers Report No. A21007 J001 Rev 1-12; DeltaDualCore™ Panel Class 10a Awning and Patio Roof System; Rev 1-10; Dated 27/05/2025. This report provides the evidence for contributing to compliance with H3P1(1) subject to site specific performance solution to the satisfaction of the Appropriate Authority as described by the NCC. The following reports are supporting compliance as referenced in SOTERA Pty Ltd; Fire Engineers Report No. A21007 J001 Rev 1-12:
  - a. AWTA; NATA Accreditation No. 1356; Test No. 19-003619; Testing in accordance with AS/NZS 1530.3-1999; Dated 30/07/2019.
  - b. CSIRO Certificate of Test: AS1530.3-1999 fire test certificate for Bluescope COLORBOND Metallic Steel Polyester, Report No. FNE11605; Dated 11/02/2016.
  - c. CSIRO Certificate of Test: AS1530.3-1999 fire test certificate for UniCote pre-painted steel sheeting, Report No. FNE11809A; Dated 12/10/2016.
  - d. CSIRO Certificate of Test: AS1530.1-1994 fire test certificate for Mineral Wool / Rockwool, Report No. FNC12604; Dated 08/07/2020.
  - e. AWTA Product Testing: AS1530.3-1999 Test Report for DeltaTrim-EPS-FR, Test Number 19-003623; Dated 31/07/2019.

The Certificate Holder has chosen not to make some of the above evidence of compliance publicly available, due to the documents being considered commercial in confidence.